627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY WALLACE CLEMENT SABINE

SPONSOR: EUREKA

Montréal, QC, Canada

Sound Absorption RALTM-A24-097

CONDUCTED: 2024-02-20

Page 1 of 8

ON: MARRO UNLIT SMALL (six objects, two rows of three objects each, rows spaced 50" on

center, objects in each row spaced 45" on center)

TEST METHODOLOGY

Riverbank Acoustical LaboratoriesTM is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2017 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-23: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-23: "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measurement procedure and room specifications are available upon request. The results presented in this report apply to the sample as received from the test sponsor.

INFORMATION PROVIDED BY SPONSOR

The test specimen was designated by the sponsor as MARRO UNLIT SMALL (six objects, two rows of three objects each, rows spaced 50" on center, objects in each row spaced 45" on center). The following nominal product information was provided by the sponsor prior to testing. The accuracy of such sponsor-provided information can affect the validity of the test results.

Product Under Test

Product Name: MARRO UNLIT SMALL

Manufacturer: EUREKA

According to the sponsor's CAD model, each sound absorbing object had an exposed surface area of 1.77 m² (19.1 ft²). The total exposed surface area of all sound-absorbing objects was 10.62 m² (114.3 ft²).

SPECIMEN MEASUREMENTS & TEST CONDITIONS

Through a full external visual inspection performed on the test specimen, Riverbank personnel verified the following information:

Test Specimen

Materials: Felt fins radially attached to central hubs, 8 fins per object, 6 objects

Object Diameter: 6 objects @ 613 mm (24.125 in.) each

Object Depth: 333 mm (13.125 in.)
Felt Fin Thickness: 8.99 mm (0.354 in.)
Overall Weight: 6.46 kg (14.25 lbs)



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY WALLACE CLEMENT SABINE

EUREKA 2024-02-20 RALTM-A24-097 Page 2 of 8

Physical Measurements (per object)

Dimensions: 0.61 m (24.125 in) diameter x 0.33 m (13.125 in) height

Weight: 1.08 kg (2.37 lbs)

Test Environment

Room Volume: 291.98 m³

Temperature: $21.1 \text{ °C} \pm 0.0 \text{ °C}$ (Requirement: $\geq 10 \text{ °C}$ and $\leq 5 \text{ °C}$ change) Relative Humidity: $59.6 \% \pm 2.8 \%$ (Requirement: $\geq 40 \%$ and $\leq 5 \%$ change)

Barometric Pressure: 99.3 kPa (Requirement not defined)

MOUNTING METHOD

Type JH-MOD Mounting: The specimen is an array of 6 spaced sound absorbing objects suspended from cables such that the closest face is located approximately 1092 mm (43 in.) from the horizontal test surface. This approximates the mounting method of a typical ceiling baffle installation. The objects were distributed in two rows of three objects each, rows spaced 50" on center, objects in each row spaced 45" on center. The width of the installed object array was 2899 mm (114.125 in.) and the length of the installed object array was 1883 mm (74.125 in.). The area of extended continuous surface attributed to the object array was 8.71 m² (93.8 ft²).

NVLAP LAB CODE 100227-0 SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY WALLACE CLEMENT SABINE

RALTM-A24-097 Page 3 of 8

EUREKA 2024-02-20

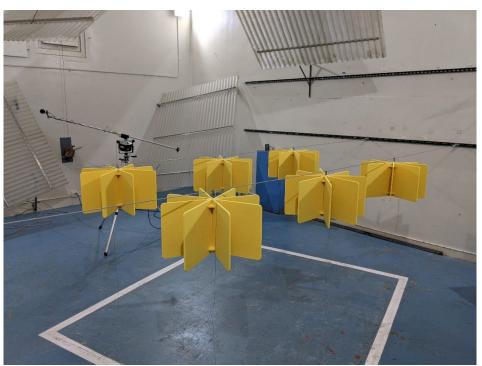


Figure 1 – Specimen mounted in test chamber

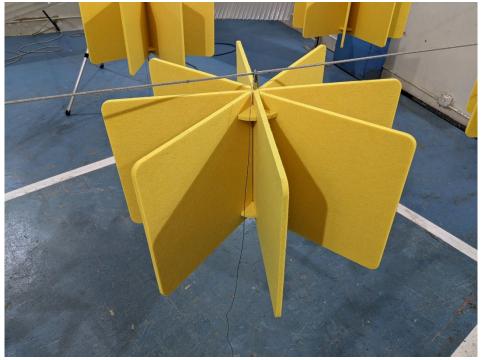


Figure 2 – Individual specimen object



RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

TESTING

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE NVLAP LAB CODE 100227-0

SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY WALLACE CLEMENT SABINE

RALTM-A24-097 Page 4 of 8

EUREKA 2024-02-20

TEST RESULTS

The preferred presentation of sound absorption test results for arrays of spaced objects is sound absorption (m²) per object and total sound absorption (m²) at each one-third-octave band

ASTM C423-23 Appendix X2 allows calculation of sound absorption per m² (SA/m²) based on the projected horizontal surface area attributable to an array of objects. The extended continuous surface area used in this calculation is to be determined using the following procedure:

 $S_{array} = (w + w_1) \times (l + l_1)$ If the set of objects consists of a rectangular array of equal sized objects with equal space between each object in a row and equal space between rows. (ASTM E423-23 X.2.3.1)

Where:

 S_{array} = area of extended continuous surface attributed to the test specimen, m² w = the measured width of the installed object array, in meters w_I = the space between objects in the array along the width, in meters l = the measured length of the installed object array, in meters l_I = the space between objects in the array along the length, in meters

The sound absorption per m² (SA/m²) is calculated based on the following formula:

$$\alpha_{\text{array}} = (A_2 - A_1)/S_{\text{array}}$$

Where:

 α_{array} = sound absorption per m² (SA/m²) of extended continuous surface, no units, A₁ = absorption of the empty reverberation room, m² and

 A_2 = absorption of the room after the specimen has been installed, m^2 .

 $S_{array} = area$ of extended continuous surface attributed to the test specimen, m²



NVLAP LAB CODE 100227-0 SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY WALLACE CLEMENT SABINE

RALTM-A24-097 Page 5 of 8

EUREKA 2024-02-20

TEST RESULTS (continued)

1/3 Octave Center Frequency	Total Absorption		Absorption per Object		α_{array} (Sabins/ft ²)
(Hz)	(m^2)	(Sabins)	· ` ` ` ` ` ` ` ` ` ` ` ` ` ` ` ` ` ` `	(SA/m^2)	
100	0.04	0.38	0.01	0.06	0.00
** 125	0.25	2.68	0.04	0.45	0.03
160	0.81	8.76	0.14	1.46	0.09
200	0.99	10.66	0.17	1.78	0.11
** 250	1.62	17.44	0.27	2.91	0.19
315	2.24	24.12	0.37	4.02	0.26
400	2.31	24.85	0.38	4.14	0.27
** 500	2.42	26.00	0.40	4.33	0.28
630	2.93	31.50	0.49	5.25	0.34
800	2.99	32.21	0.50	5.37	0.34
** 1000	3.18	34.25	0.53	5.71	0.37
1250	3.54	38.07	0.59	6.34	0.41
1600	3.83	41.24	0.64	6.87	0.44
** 2000	4.02	43.25	0.67	7.21	0.46
2500	4.30	46.23	0.72	7.71	0.49
3150	4.52	48.70	0.75	8.12	0.52
** 4000	4.86	52.36	0.81	8.73	0.56
5000	5.07	54.54	0.84	9.09	0.58

Array-NRC 0.35 over 8.71 m² of extended continuous surface area Array-SAA 0.33 over 8.71 m² of extended continuous surface area

Tested by Marc Sciaky

Senior Experimentalist

Report by

Keith Kimberling

Test Engineer

Approved by

Eric P. Wolfram Laboratory Manager

Note: Sound absorption per m^2 (SA/ m^2), and therefore the reported Single Number Ratings, are highly dependent on the exact sample shape, size, spacing, and extended continuous surface area present in the test and subsequent calculations. Changes to any of these parameters will change the resulting values. These presented results are valid only for the specific configuration present in this test.

NVLAP LAB CODE 100227-0 SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

®RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE

627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report

www.riverbankacoustics.com


FOUNDED 1918 BY WALLACE CLEMENT SABINE

RALTM-A24-097 Page 6 of 8

EUREKA 2024-02-20

SOUND ABSORPTION REPORT

MARRO UNLIT SMALL (six objects, two rows of three objects each, rows spaced 50" on center, objects in each row spaced 45" on center)

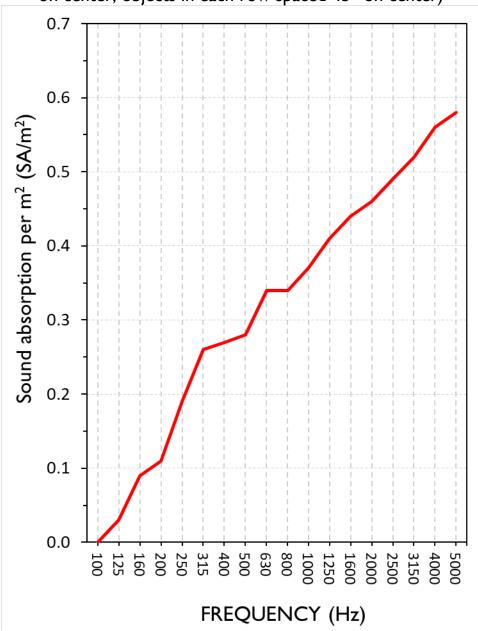

Array-NRC 0.35 over 8.71 m² of extended continuous surface area Array-SAA 0.33 over 8.71 m² of extended continuous surface area

NVLAP LAB CODE 100227-0 SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

®RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE

627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY WALLACE CLEMENT SABINE

EUREKA 2024-02-20

RALTM-A24-097 Page 7 of 8

APPENDIX A: Extended Frequency Range Data

Specimen: MARRO UNLIT SMALL (six objects, two rows of three objects each, rows spaced 50" on center, objects in each row spaced 45" on center) (See Full Report)

The following non-accredited data were obtained in accordance with ASTM C423-23, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.

1/3 Octave Band Center Frequency	Total Absorption		Absorption	α_{array} (Sabins/ft ²)	
(Hz)	(m^2)	(Sabins)	(m ² /Object)	(Sabins / Object)	(SA/m^2)
31.5	0.23	2.50	0.04	0.42	0.03
40	0.45	4.82	0.07	0.80	0.05
50	-0.58	-6.27	-0.10	-1.05	-0.07
63	0.05	0.55	0.01	0.09	0.01
80	0.24	2.57	0.04	0.43	0.03
100	0.04	0.38	0.01	0.06	0.00
125	0.25	2.68	0.04	0.45	0.03
160	0.81	8.76	0.14	1.46	0.09
200	0.99	10.66	0.17	1.78	0.11
250	1.62	17.44	0.27	2.91	0.19
315	2.24	24.12	0.37	4.02	0.26
400	2.31	24.85	0.38	4.14	0.27
500	2.42	26.00	0.40	4.33	0.28
630	2.93	31.50	0.49	5.25	0.34
800	2.99	32.21	0.50	5.37	0.34
1000	3.18	34.25	0.53	5.71	0.37
1250	3.54	38.07	0.59	6.34	0.41
1600	3.83	41.24	0.64	6.87	0.44
2000	4.02	43.25	0.67	7.21	0.46
2500	4.30	46.23	0.72	7.71	0.49
3150	4.52	48.70	0.75	8.12	0.52
4000	4.86	52.36	0.81	8.73	0.56
5000	5.07	54.54	0.84	9.09	0.58
6300	5.30	57.07	0.88	9.51	0.61
8000	5.84	62.85	0.97	10.47	0.67
10000	6.24	67.22	1.04	11.20	0.72
12500	6.84	73.60	1.14	12.27	0.79



®RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

TESTING UT THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE NVLAP LAB CODE 100227-0 SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

627 RIVERBANK DRIVE GENEVA, IL 60134 630-232-0104

Test Report

www.riverbankacoustics.com

FOUNDED 1918 BY WALLACE CLEMENT SABINE

EUREKA 2024-02-20

RALTM-A24-097
Page 8 of 8

APPENDIX B: Instruments of Traceability

Specimen: MARRO UNLIT SMALL (six objects, two rows of three objects each, rows spaced 50" on center, objects in each row spaced 45" on center) (See Full Report)

		Serial	Date of	Calibration
Description	Model	Number	Certification	<u>Due</u>
System 1	Type 3160-A-042	3160- 106968	2023-07-17	2024-07-17
Bruel & Kjaer Mic And Preamp G	Type 4943-B-001	2525858	2023-05-03	2024-05-03
Bruel & Kjaer Pistonphone	Type 4228	2781248	2023-07-12	2024-07-12
EXTECH Hygro 6015	SD700	A.116015	2023-05-31	2024-05-31

APPENDIX C: Revisions to Original Test Report

Specimen: MARRO UNLIT SMALL (six objects, two rows of three objects each, rows spaced 50" on center, objects in each row spaced 45" on center) (See Full Report)

<u>Date</u>	Revision		
2024-03-05	Original report issued		

END

